

Capital Ballroom Exhibitor Layout (Rev. 7/16/25)

Downstairs from Hotel Lobby, directly below Registration.

EXHIBITOR HOURS:

WEDNESDAY: 9:30 AM – 6.00 PM

THURSDAY: 7:30 AM – 3:30 PM


NOTE: Map scale is approximate.

Booth Size:

Approximately 8'x8'X14' high

One table (6'x30")

Two chairs and power.

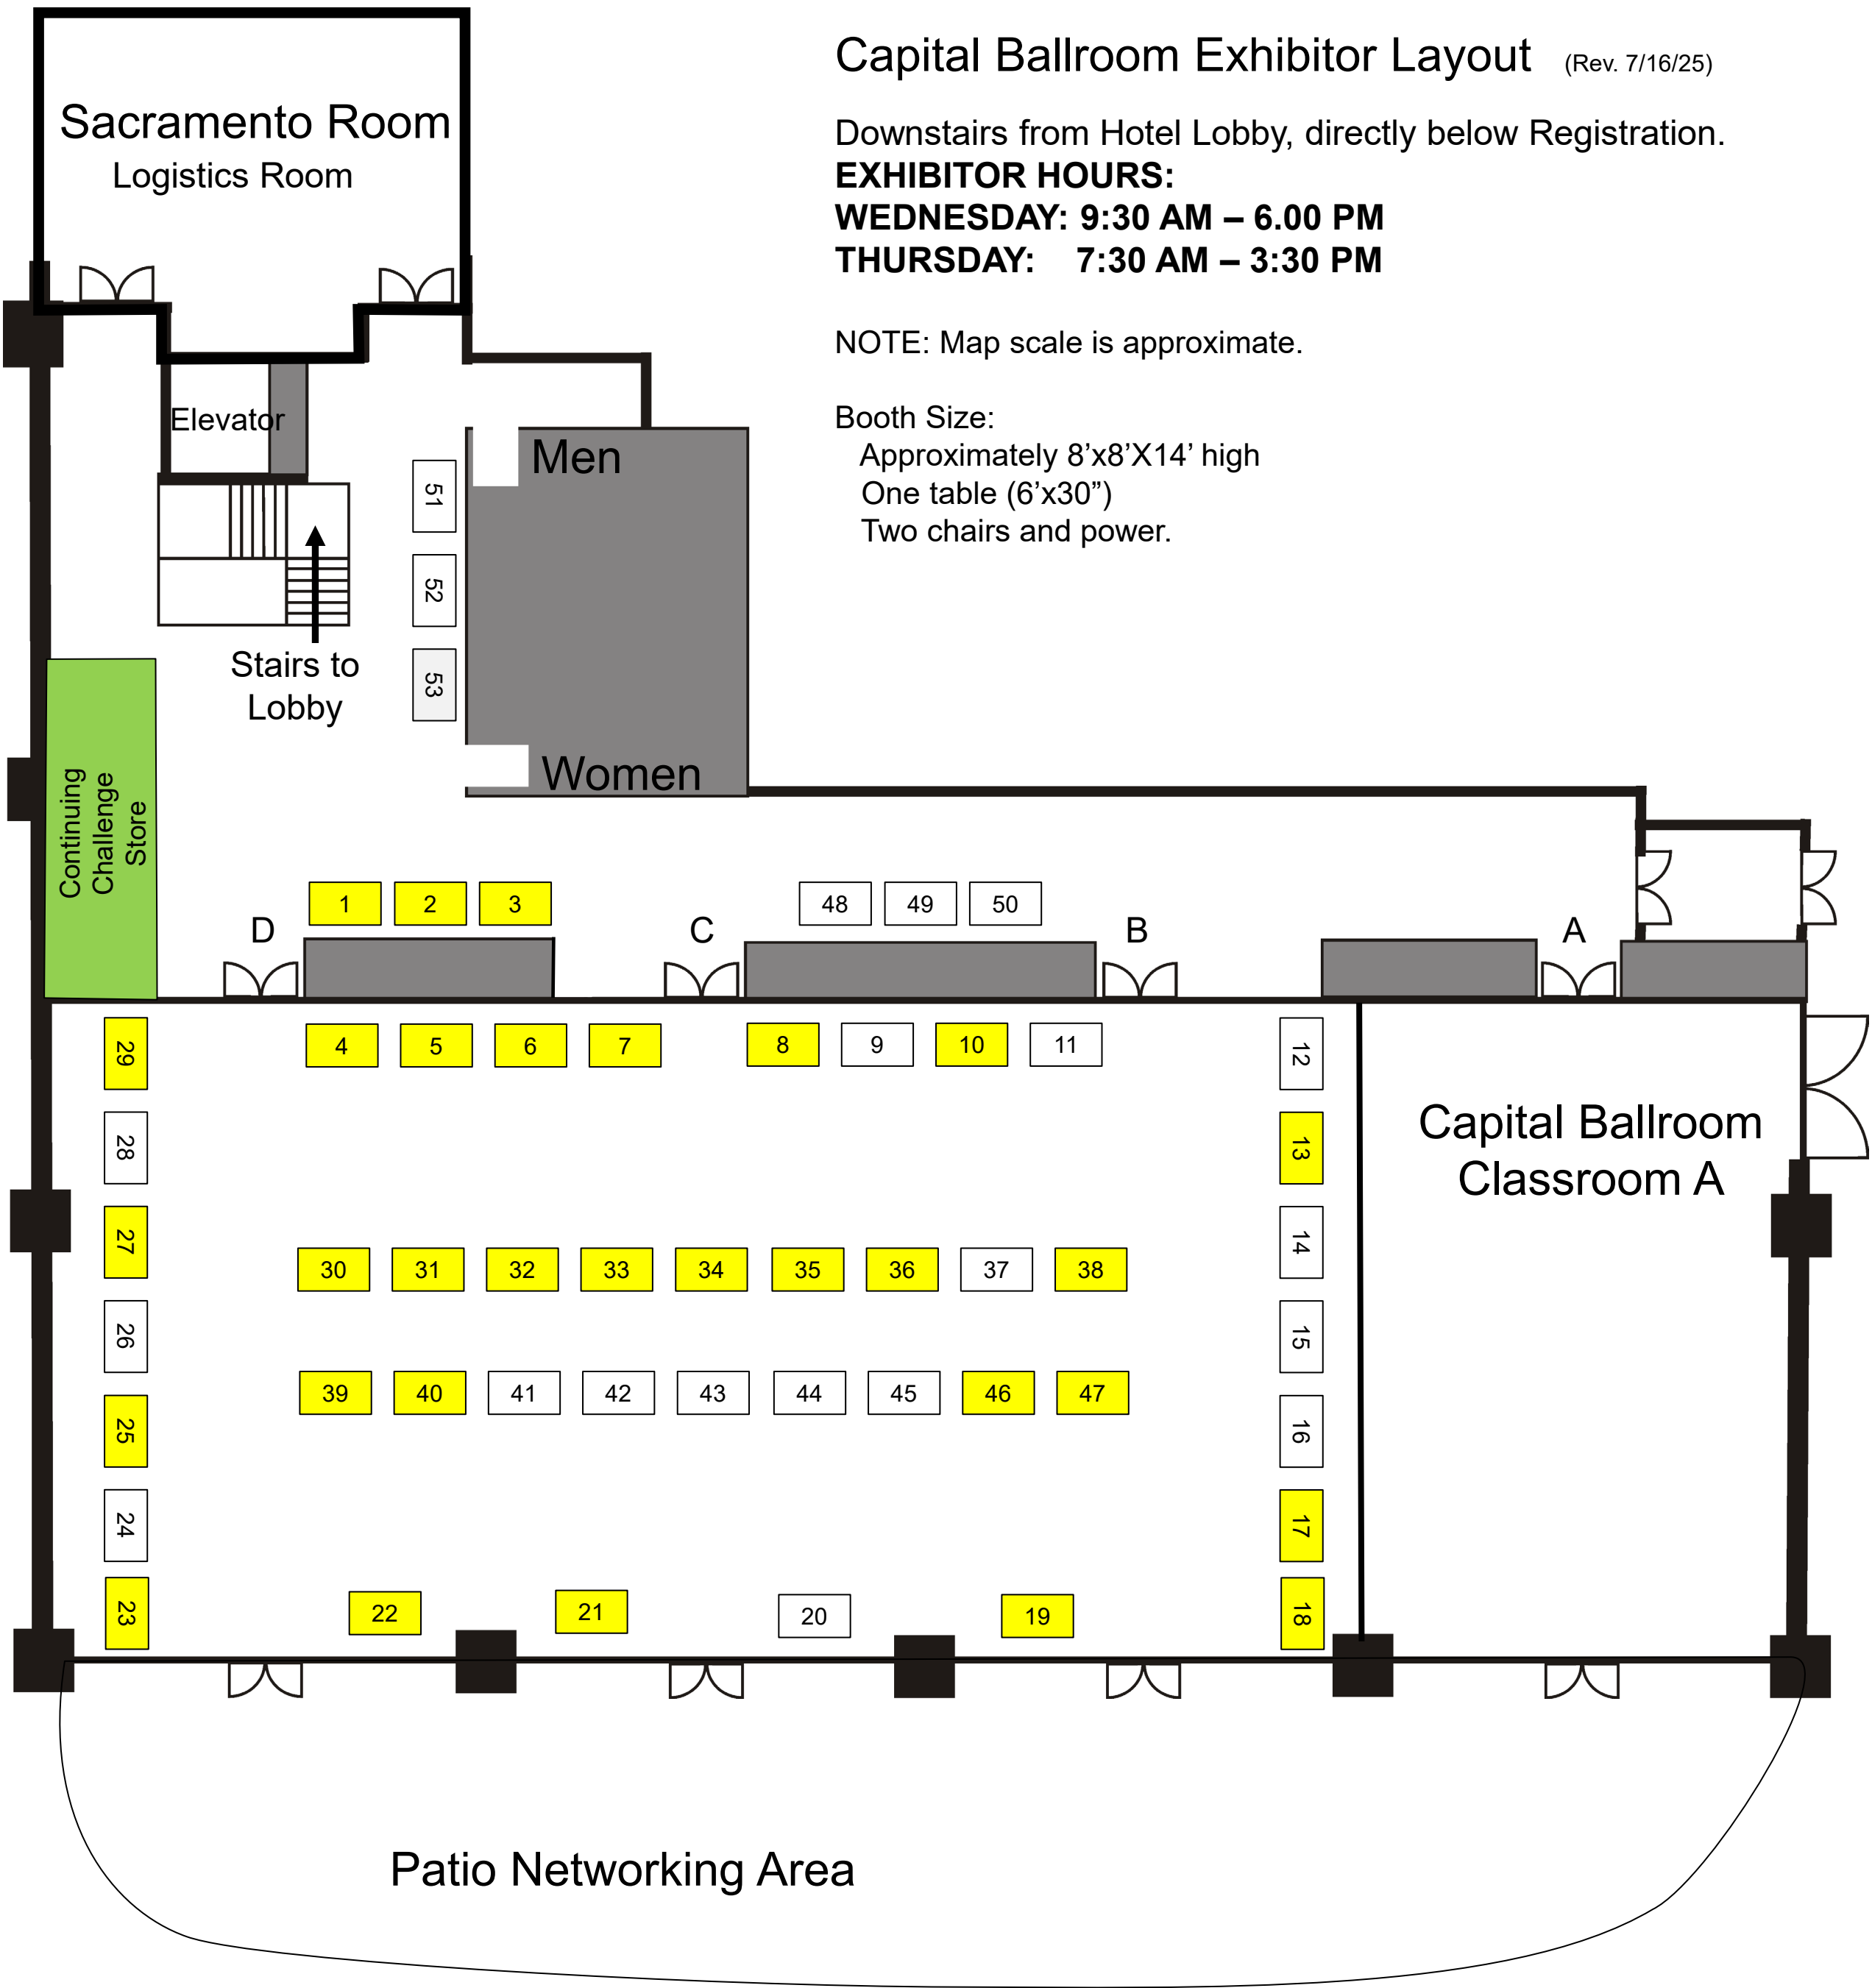

Booth Selection Process

- 1) Choose your booth from this layout. Booths already assigned are highlighted in yellow on this diagram. All registered Exhibitors are listed on page 2 and 3
- 2) Place your Booth selection numbers in your online Exhibitor Registration form when asked for booth selection choice(s).
- 3) Booth selections are made by online registration date or at the discretion of the Continuing Challenge Committee. We will do our best to accommodate your request. The exhibitor map will be updated every 2 weeks as needed.
- 4) Around the middle of June we will email you an 'Exhibitor Booth Set-up Information' document. Your booth number will be listed on the top. Please confirm that the information listed is correct or provide requested changes in a reply to the email sent.

Table	Exhibitor	Table	Exhibitor
1	AristaTek, Inc	19	ORTEC
2	Ponder Environmental Services	20	
3	CalOES/CSTI	21	Spill Bully
4	Agilent Technologies	22	908 Devices
5	Hazmat Resource	23	ZUMRO by Air Shelters USA, LLC
6	Hazmat Resource	24	
7	State Fire Training	25	Thermo Fisher Scientific
8	Proengin Inc	26	
9		27	National Association of State Fire Marshals
10	Symetrica	28	
11		29	Haz Tech Sytems Inc.
12		30	Patriot Environmental Services
13	Pendar Technologies	31	Allstar Fire equipment/ Lion
14		32	Allstar Fire equipment/ Lion
15		33	Bertin Environics
16		34	CDPH
17	Safeware Inc.	35	Columbia Southern University
18	Safeware Inc.	36	RKI Instruments, Inc.

Table	Exhibitor		Front Parking Area Static Display
37		1	
38	AET HazMat Training Props	2	
39	NES, Inc. / NCC Training	3	
40	Ludlum Measurements	4	
41		5	
42		6	
43		7	
44		8	
45		9	
46	Newson Gale	10	
47	Safe Environment Engineering		
48			
49			
50			
51			
52			
53			